


3/8" EXPANSION JOINTS
(TYP.) SEE NOTE 2

COMMERCIAL: 24' MIN FOR TWO LANES
12' MIN. FOR ONE LANE

RESIDENTIAL: VARIABLE 10' MIN. 20' MAX.

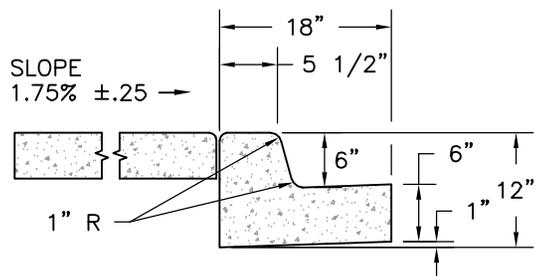

NOTES:

1. DUMMY JOINTS SHALL BE PLACED NOT TO EXCEED 15' O.C. NOR LESS THAN 5' O.C. THEY SHALL NOT BE LESS THAN 3/16" THICK AND SHALL EXTEND 1-1/4" DEEP.
2. 1/2" THRU-JOINTS SHALL BE PLACED AT BACK, SIDES AND FRONT (BEHIND CURB) OF APPROACH.
3. CEMENT CONCRETE SHALL HAVE A MINIMUM 3000PSI 28-DAY STRENGTH WITH 5%±1 ENTRAINED AIR.
4. ALL JOINTS SHALL BE CLEANED AND EDGED.
5. APPROACH SHALL NOT BE POURED INTEGRAL WITH CURB AND GUTTER.
6. SUBGRADE COMPACTION SHALL BE TO 95% MODIFIED PROCTOR DENSITY.
- * 7. THE ACCAPTABLE CROSS SLOPE OF SIDEWALK SHALL NOT BE LESS THAN 1.5% AND NOT GREATER THAN 2.0%.

NOT TO SCALE

	<p><i>City of Oak Harbor</i></p> <p>ENGINEERING DEPARTMENT 865 SE Barrington Drive Oak Harbor, WA 98277</p>	<p>Concrete Sidewalk Driveway Detail</p>
	<p>ST-7 CONCRETE DRIVEWAY DETAIL_5-30-18.DWG</p>	