



NOTES:

1. FORMS SHALL BE METAL OR WOOD AND SHALL EXTEND THE FULL DEPTH OF CONCRETE.
2. SIDEWALKS SHALL BE BROOM FINISHED
3. FIBERBOARD EXPANSION JOINTS SHALL BE SPACED AT 15- FEET O.C.
4. SCORED DUMMY JOINTS SHALL BE PLACED AT 5- FEET O.C.
5. CURB AND SIDEWALK TERMINI SHALL BE RAMPED OR BEVELED TO MATCH LOCAL GRADE AS DIRECTED BY THE CITY ENGINEER
6. CEMENT CONCRETE SHALL HAVE A MINIMUM 3000psi 28-day STRENGTH WITH 5% ±1 ENTRAINED AIR
- *7. THE ACCEPTABLE CROSS SLOPE OF SIDEWALK SHALL NOT BE LESS THAN 1.5% AND NOT GREATER THAN 2.0%.

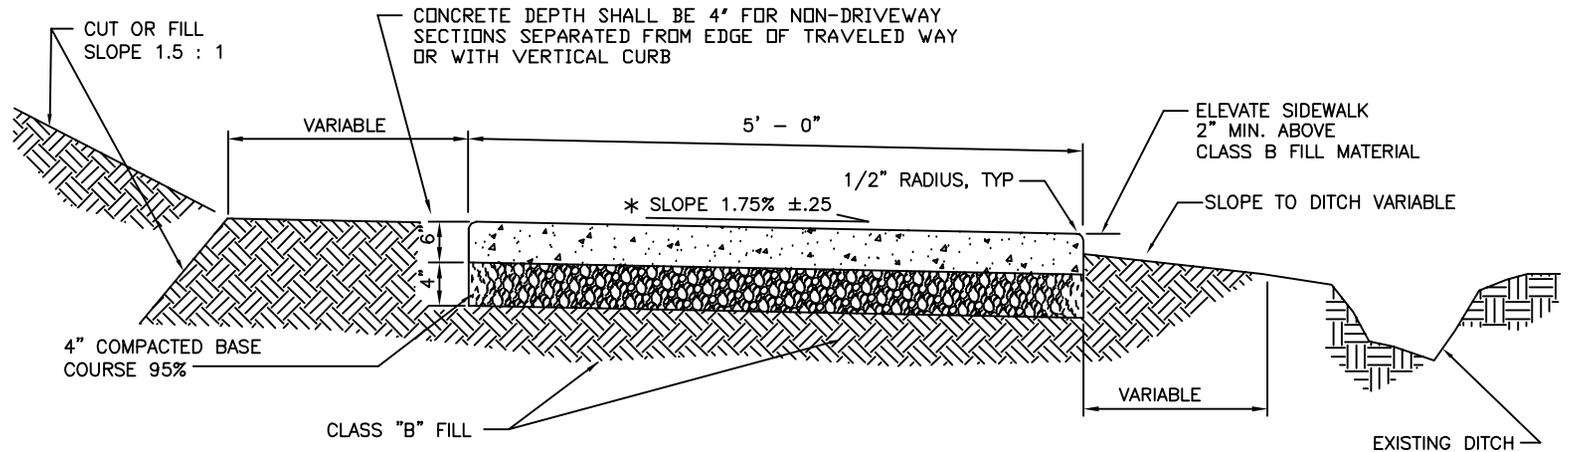

NOT TO SCALE

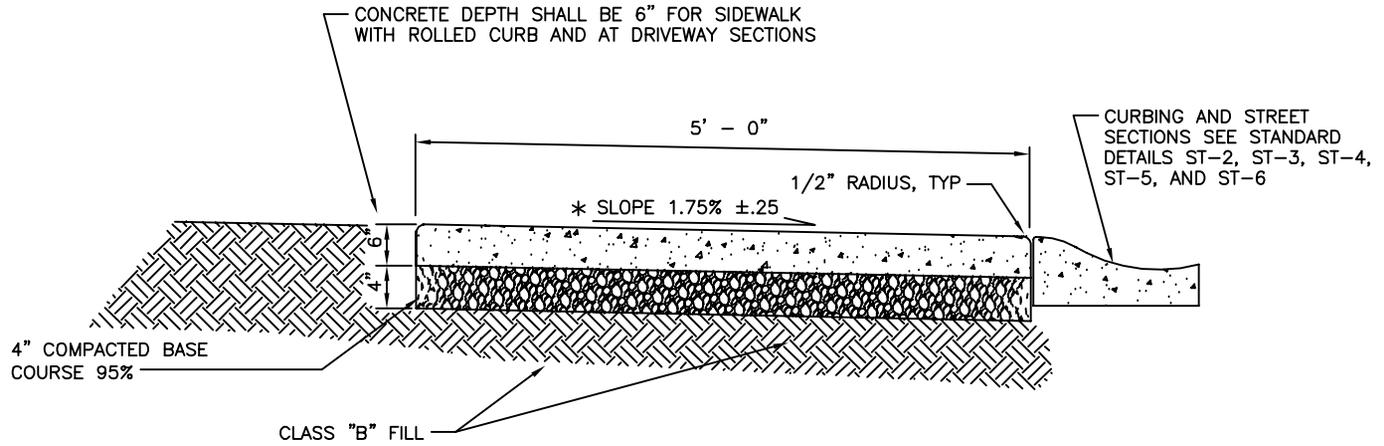

City of
Oak Harbor
ENGINEERING DEPARTMENT
865 SE Barrington Drive
Oak Harbor, WA 98277

SIDEWALK SECTION
DETAIL

ST-8 SIDEWALK_SECTION_5-30-18.DWG