


VERTICAL CURB
TYPICAL SECTION
(NOT TO SCALE)

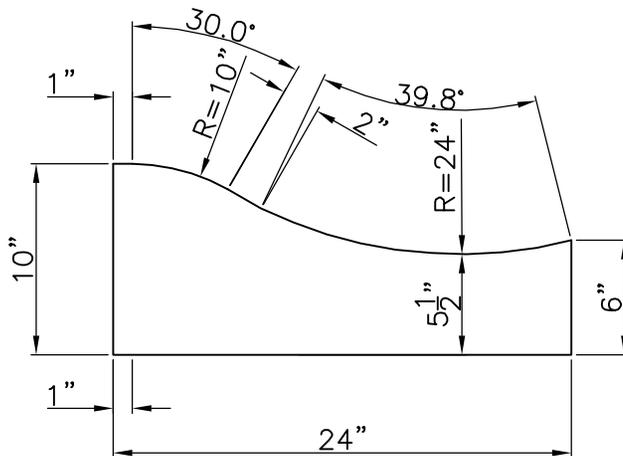

ROLLED CURB
TYPICAL SECTION
(NOT TO SCALE)

NOTES:

1. FORMS SHALL BE METAL OR WOOD AND SHALL EXTEND THE FULL DEPTH OF THE CONCRETE
2. SIDEWALKS SHALL BE BRUSH OR BROOMED FINISHED
3. FIBERBOARD EXPANSIONS JOINTS SHALL BE PLACE AT 15' o.c.
4. SIDEWALKS SHALL BE SCORED (DUMMY JOINTS) AT 5' o.c.
5. CONCRETE SHALL HAVE A MINIMUM 28-DAY STRENGTH OF 3,000psi WITH 5%±1 ENTRAINED AIR.
6. SIDEWALK TERMINUS SHALL BE RAMPED WITH CONCRETE OR ASPHALT TO MATCH LOCAL GRADE CONDITIONS AS DIRECTED BY THE CITY ENGINEER.

NOT TO SCALE



*City of
Oak Harbor*
ENGINEERING DEPARTMENT
865 SE Barrington Drive
Oak Harbor, WA 98277

CURBING SECTIONS