


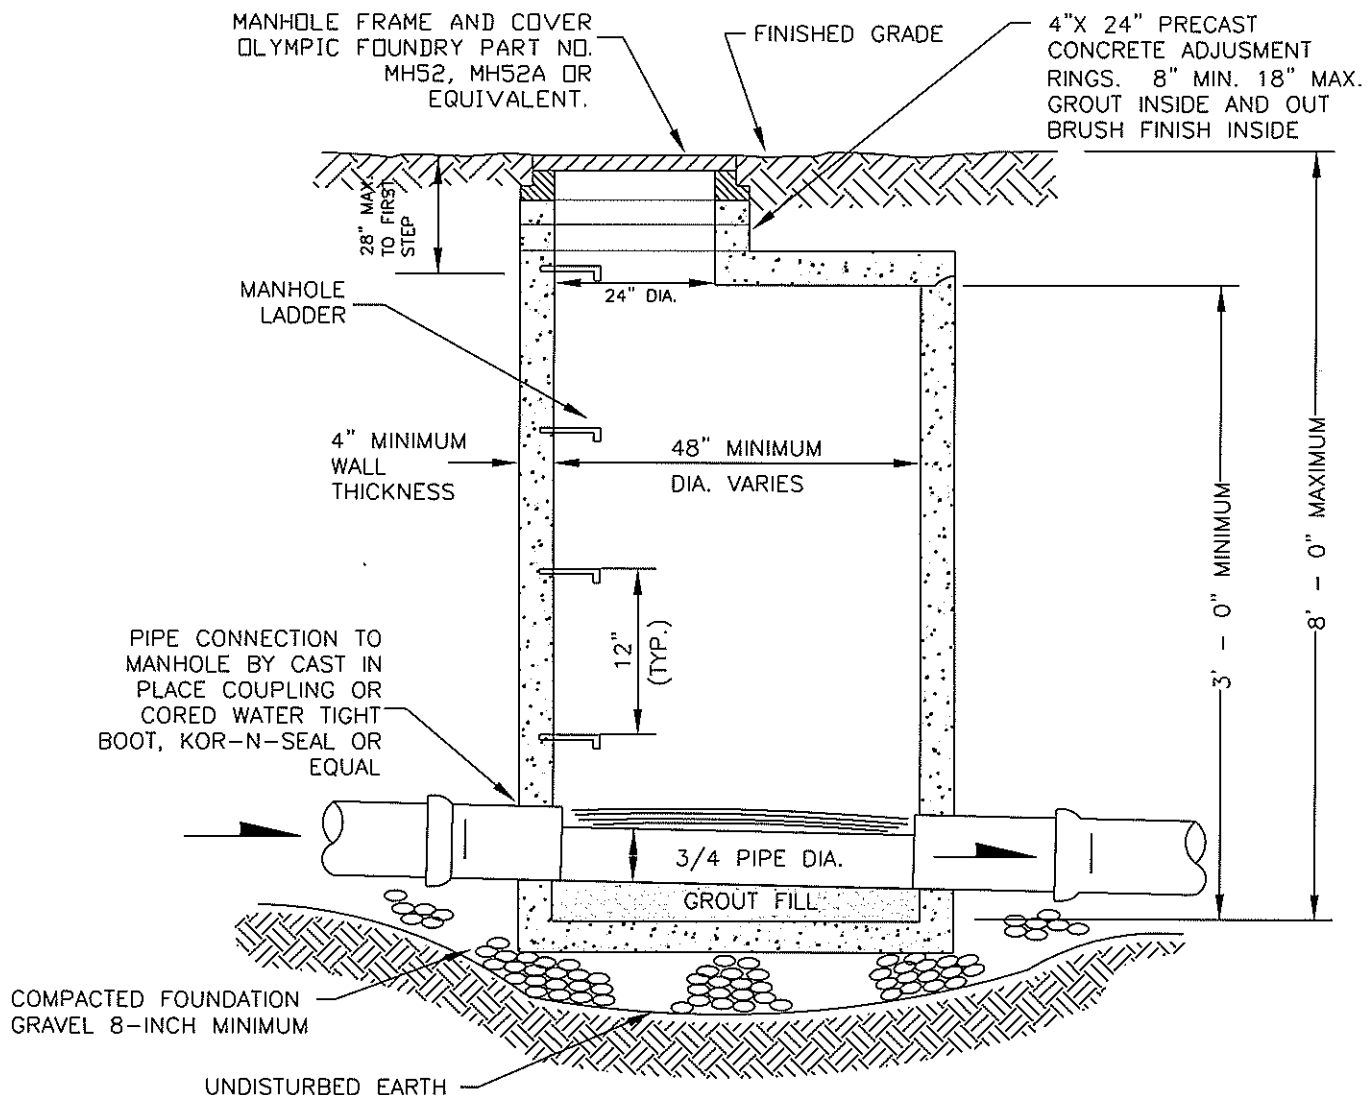

NOTES:

1. DROP OF GRADE THROUGH MANHOLE SHALL BE 0.1-FT UNLESS OTHERWISE APPROVED BY CITY ENGINEER.
2. MANHOLES SHALL COMPLY WITH WSDOT STANDARD SPECIFICATIONS FOR TYPE III MANHOLES
3. PIPES SHALL PROTRUDE NO MORE THAN 1-inch INTO MANHOLE.

APPROVED
City of Oak Harbor
Engineering Dept

Signature

6/8/06
Date



City of
Oak Harbor
ENGINEERING DEPARTMENT
865 SE Barrington Drive
Oak Harbor, WA 98277

TYPE III MANHOLE